

ADVISE

OPPOSITE SIDE TEMPERATURE _____ °

ADVISE

MOUNT SIDE TEMPERATURE _____ °

SLIDE DIRECTION

PANEL SLIDE DIRECTION: ☐ LEFT HAND

PANEL SLIDE DIRECTION: ☒ RIGHT HAND (SHOWN)

APPLICATION DATA

ADVISE

WASHDOWN ENVIRONMENT: YES ☐ OR NO ☐

DOOR PANEL MATERIAL:

☒ - ISOFLEX

DOOR PANEL TYPE:

☒ COOLER - 4" THICK

WALL TRACK SYSTEM:

☒ STAINLESS STEEL

FACE FRAME CONSTRUCTION:

☒ ALUMINUM W/POLYPROPYLENE COVERS

HEADER MATERIAL:

☒ ALUMINUM/ZINC/GALVANIZED

OPERATOR TYPE:

☒ NONE - MANUAL DOOR

VOLTAGE:

☒ NONE - MANUAL DOOR

MIRROR HEADER:

☒ - NONE

INSIDE TRIM:

☒ - NONE

JAMB CAPPING:

☒ - NONE

SPECIAL NOTES

TAG DOOR AS: *****ADVISE*****

***** ADVISE *****

- * DOOR TAG:
- * SLIDE DIRECTION: RIGHT HAND (SHOWN), LEFT HAND IS OPPOSITE
- * VOLTAGE: 115V OR 230V, 1ø
- * APPLICATION DATA: WASHDOWN ENVIRONMENT - YES OR NO?
- * MOUNT SIDE TEMP: _____ °
- * OPPOSITE SIDE TEMP: _____ °


APPROVAL DRAWING



5848 North 95th Court
Milwaukee, WI 53225
1-800-558-7068
www.asidoors.com

TITLE SINGLE SLIDE ISOFLEX DOOR,
RIGHT HAND, MANUAL, 4" COOLER

DRAWN BY	DATE	SHEET 1 OF	DRAWING NO.	REV.
----------	------	---------------	-------------	------


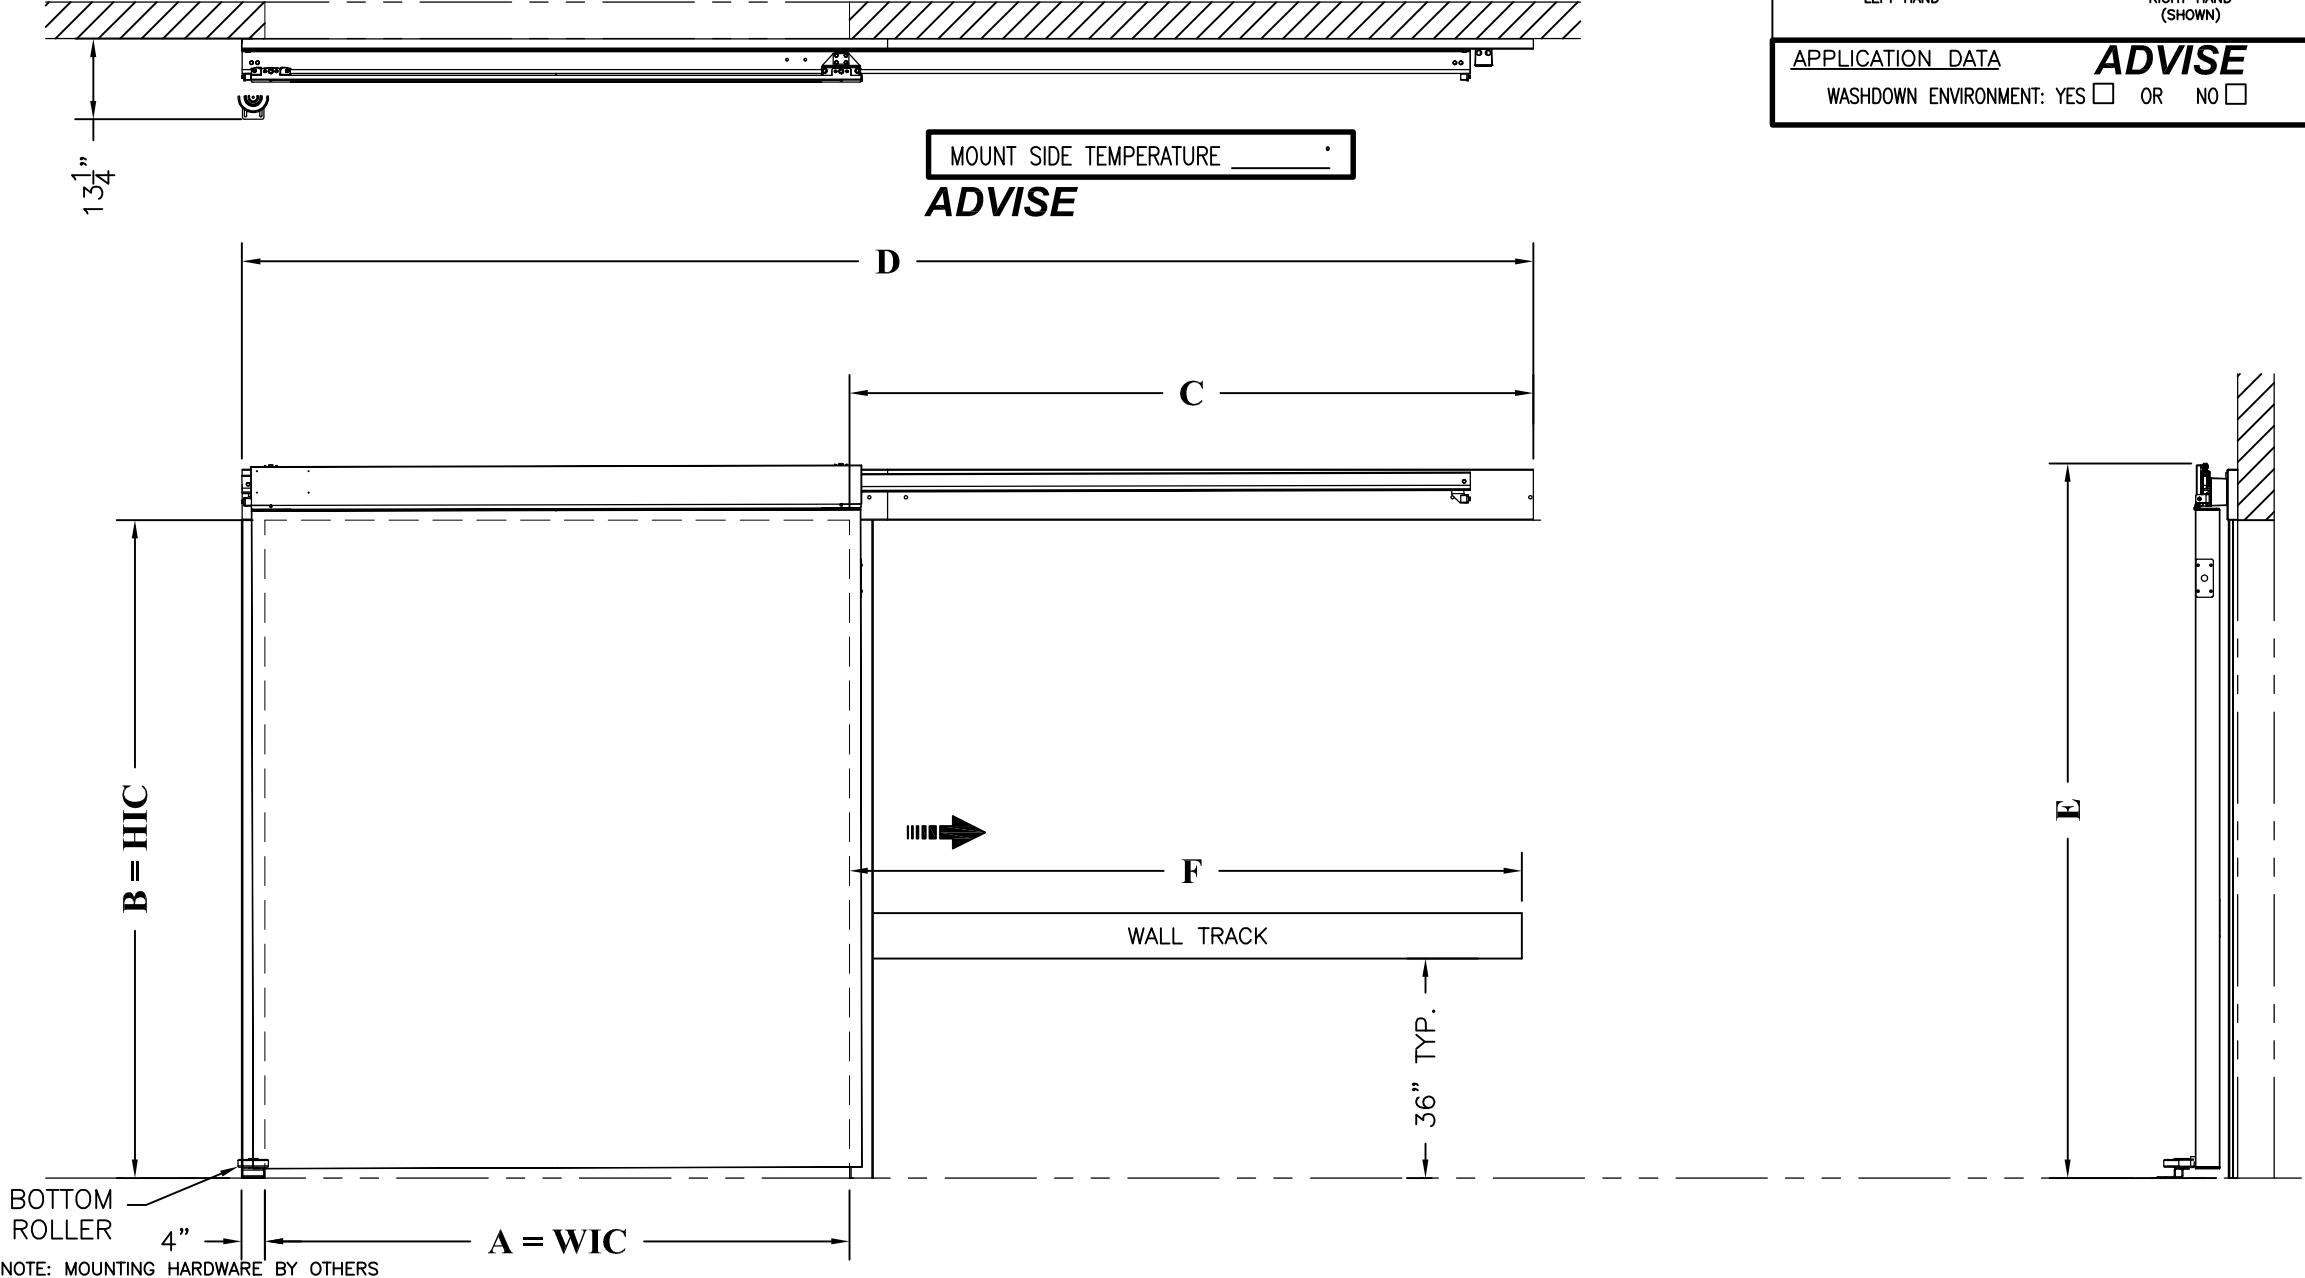


NOTE: MOUNTING HARDWARE BY OTHERS

	DOOR DIMENSIONS		
	BUILD WIC	A	8'-0"
	BUILD HIC	B	10'-0"
	A + 16 1/2"	C	9'-4 1/2"
	2A + 20"	D	17'-8"
MOTOR/CONTROL SYSTEM AMP DRAW	B + 11"	E	10'-11"
	A + 15"	F	9'-3"

VOLT/PHASE	RECOMMENDED SERVICE
460/3	2.8 AMPS
230/1	5.5 AMPS
115/1	11 AMPS

NOTE: 230 VAC CONTROLS ARE SET TO WORK WITH EITHER SINGLE PHASE OR 3 PHASE POWER INPUT.

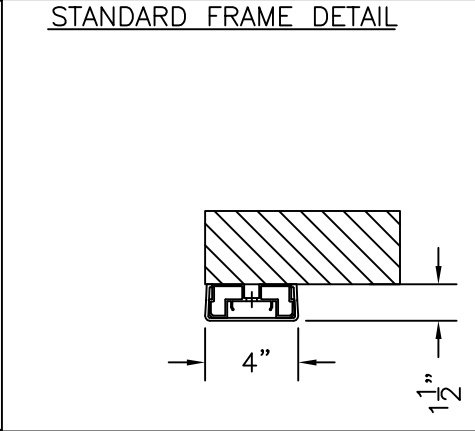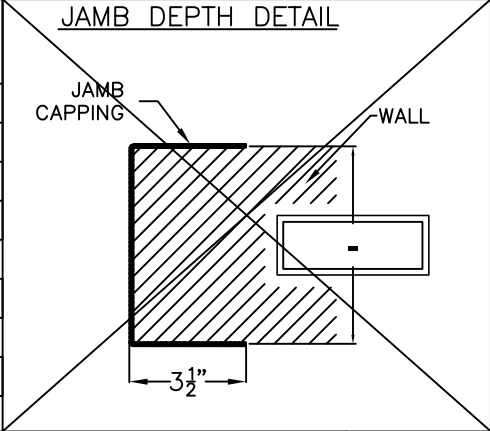

APPROVALS

FABRICATION CAN PROCEED ACCORDING TO THE SPECIFICATION SHOWN EXCEPT AS NOTED.

BY _____ DATE _____

ASI JOB NUMBER:
CUSTOMER ORDER NUMBER:
SOLD TO:
END USER:

QUANTITY OF DOORS:
DOOR MODEL NO: XP 2700
DOOR ASSEMBLY NO: 90B0008
ELECTRICAL DRAWING NO: