
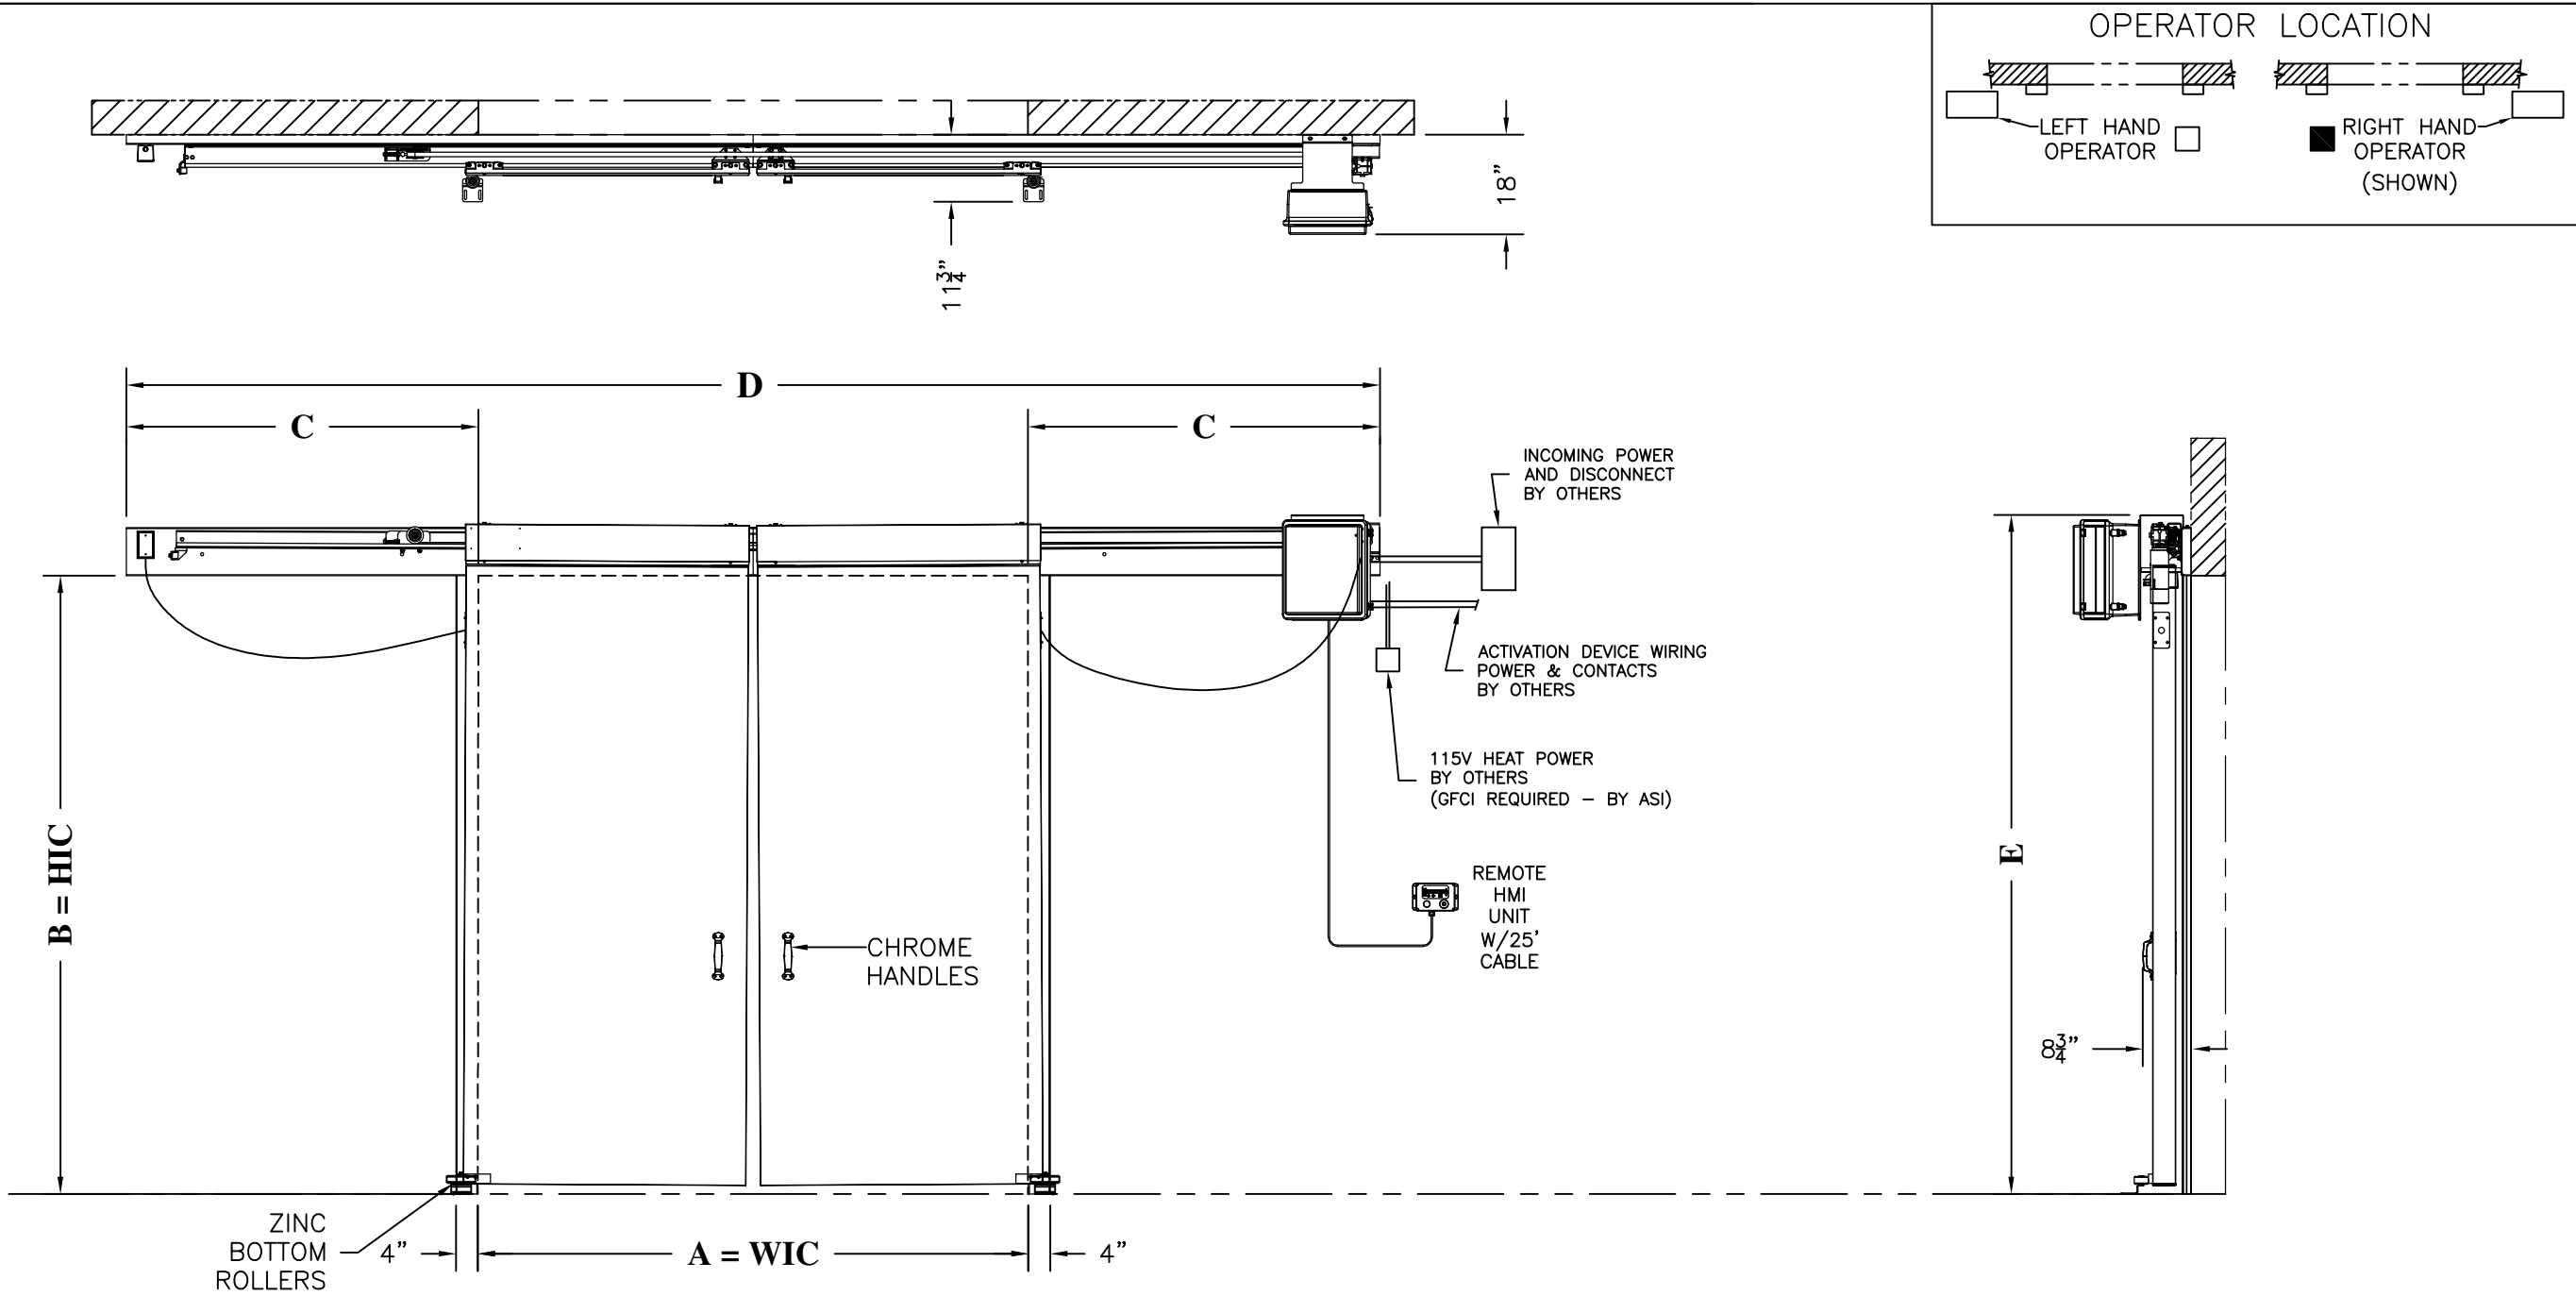




APPLICATION DATA		DOOR DIMENSIONS		STANDARD FRAME DETAIL									
ADVISE WASHDOWN ENVIRONMENT: YES ☐ OR NO ☐													
NOTE: MOUNTING HARDWARE BY OTHERS		BUILD WIC	A										
HEAT SYSTEM AMP DRAW		BUILD HIC	B										
_____ AMPS @ 115V		A/2 + 13 1/2"	C										
NOTE: 115V HEAT POWER BY OTHERS (GFCI REQUIRED)		2A + 27"	D										
MOTOR/CONTROL SYSTEM AMP DRAW													
<table><tr><td>VOLT/PHASE</td><td>RECOMMENDED SERVICE</td></tr><tr><td>460/3</td><td>2.8 AMPS</td></tr><tr><td>230/1</td><td>5.5 AMPS</td></tr><tr><td>115/1</td><td>11 AMPS</td></tr></table>		VOLT/PHASE	RECOMMENDED SERVICE	460/3	2.8 AMPS	230/1	5.5 AMPS	115/1	11 AMPS	B + 11"	E		
VOLT/PHASE	RECOMMENDED SERVICE												
460/3	2.8 AMPS												
230/1	5.5 AMPS												
115/1	11 AMPS												
NOTE: 230 VAC CONTROLS ARE SET TO WORK WITH EITHER SINGLE PHASE OR 3 PHASE POWER INPUT.													
NOTE: DOOR DETAIL NOT TO SCALE													
NOTE: DOOR DETAIL NOT TO SCALE		RIGHT HAND SLIDE SHOWN MIRROR DIMENSIONS FOR LEFT HAND SLIDE		DOOR MODEL NO: ISO-Cool 2500 DOOR ASSEMBLY NO: XP2002									
													
				ASI DOORS PERFORMANCE 5848 North 95th Court Milwaukee, WI 53225 1-800-558-7068 www.asidoors.com									
				TITLE ISO-COOL 2500 BI-PART									
				DRAWN BY	DATE								
				SHEET 1 OF									
				DRAWING NO.	REV.								